



UTILITY JOINT USE SEPERATION REQUIREMENTS

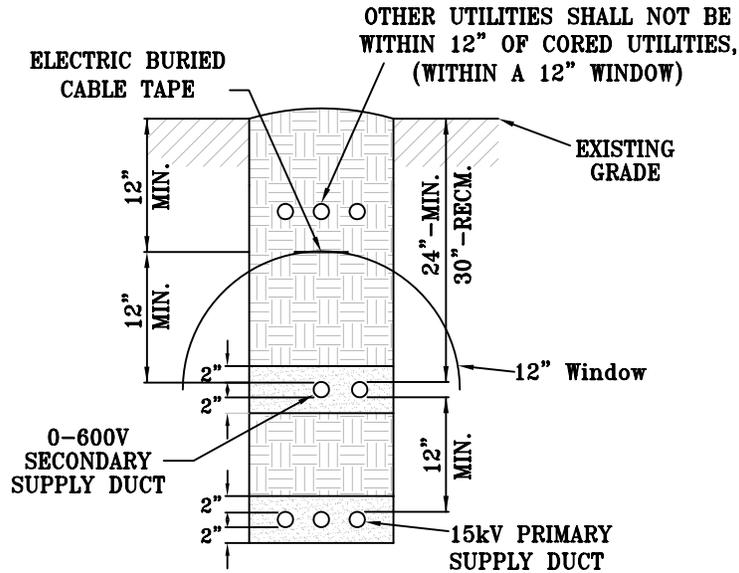


PRIMARY AND SECONDARY SUPPLY WITH JOINT USE

UNDISTURBED EARTH
 COMPACTED BACKFILL
 SAND OR CLEAN SOIL

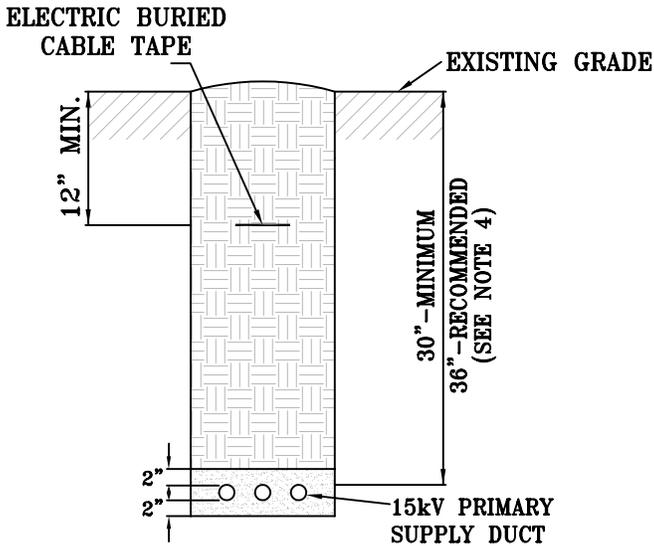

PRIMARY SUPPLY

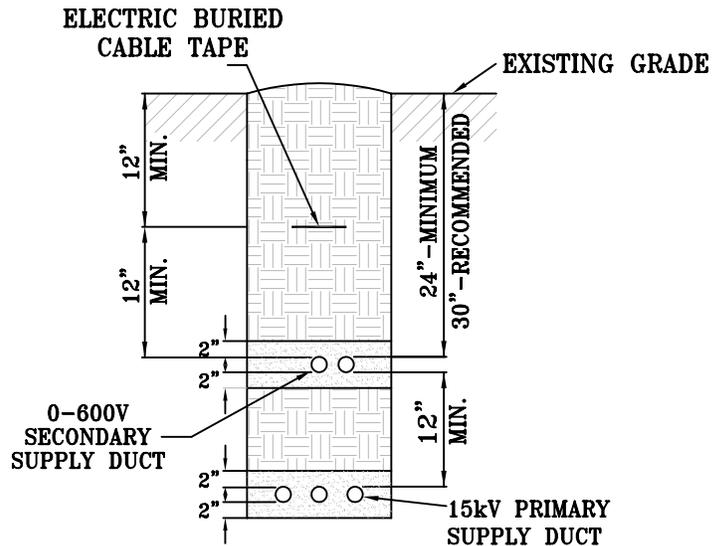

PRIMARY AND SECONDARY SUPPLY

NOTES:

1. 12" spacing between cable ducts is required in case of maintenance and repair work.
2. Conduit spacers are recommended.
3. See CORED Standard 611 for conditions requiring encasement.
4. NESC minimum from grade to top of primary supply conduit is 30". Bends are 36", so we recommend a 36" depth.

TRENCHES FOR DIRECT BURIED DUCTS AND JOINT USE DITCHING SPECIFICATIONS

REV	DATE	DRWN	APPD	DESCRIPTION	SUPERSEDES: 458.S01.R02	SCALE: NTS
1	1-01-10	PWS	MEB	HANDBOOK UPDATE.	DRWN: MESA APPD: MEB	DATE: 3-1-07
-					CORED STANDARD NUMBER	610 R 1