


RIGID SCH. STEEL POST
5" I.D. X 8'-0" LONG,
CONCRETE FILLED

TOP VIEW
OF
CORED PAD MOUNTED TRANSFORMER

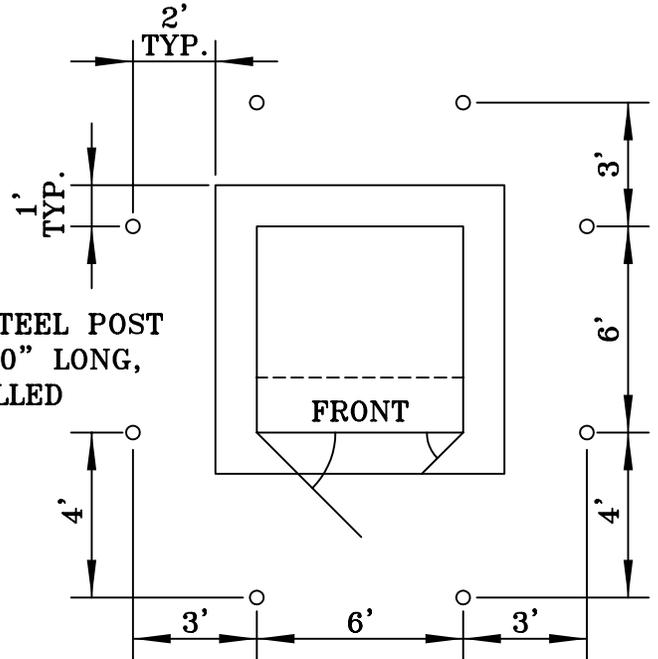

TYPICAL
GUARD POST
ARRANGEMENT

Notes:

1. Developer is to furnish and install all guard posts and concrete as required.
2. Quantity and arrangement of guard posts are to be determined by location of CORED pad mounted transformer in relation to parking areas and drive areas.
3. Guard posts are to be rigid sch. steel, 5" i.d. x 8'-0" long, concrete filled and set in an 18" diameter concrete filled hole.
4. Chance C1-12-0275 84" Bumper Posts are an acceptable substitute.

GUARD POST DETAILS

REV	DATE	DRWN	APPD	DESCRIPTION	SUPERSEDES: CORED482.R01	SCALE: NTS	
1	1-01-10	PWS	MEB	HANDBOOK UPDATE.	DRWN: MESA	APPD: MEB	DATE: 3-1-07
-					CORED STANDARD NUMBER	660	R 1